


# BUNDUCAN 2 PUMP STATION & GROUND RESERVOIR



- Existing 10"Ø PVC Pipe
- 195m HDD HDPE Pipe 10"Ø
- PNR

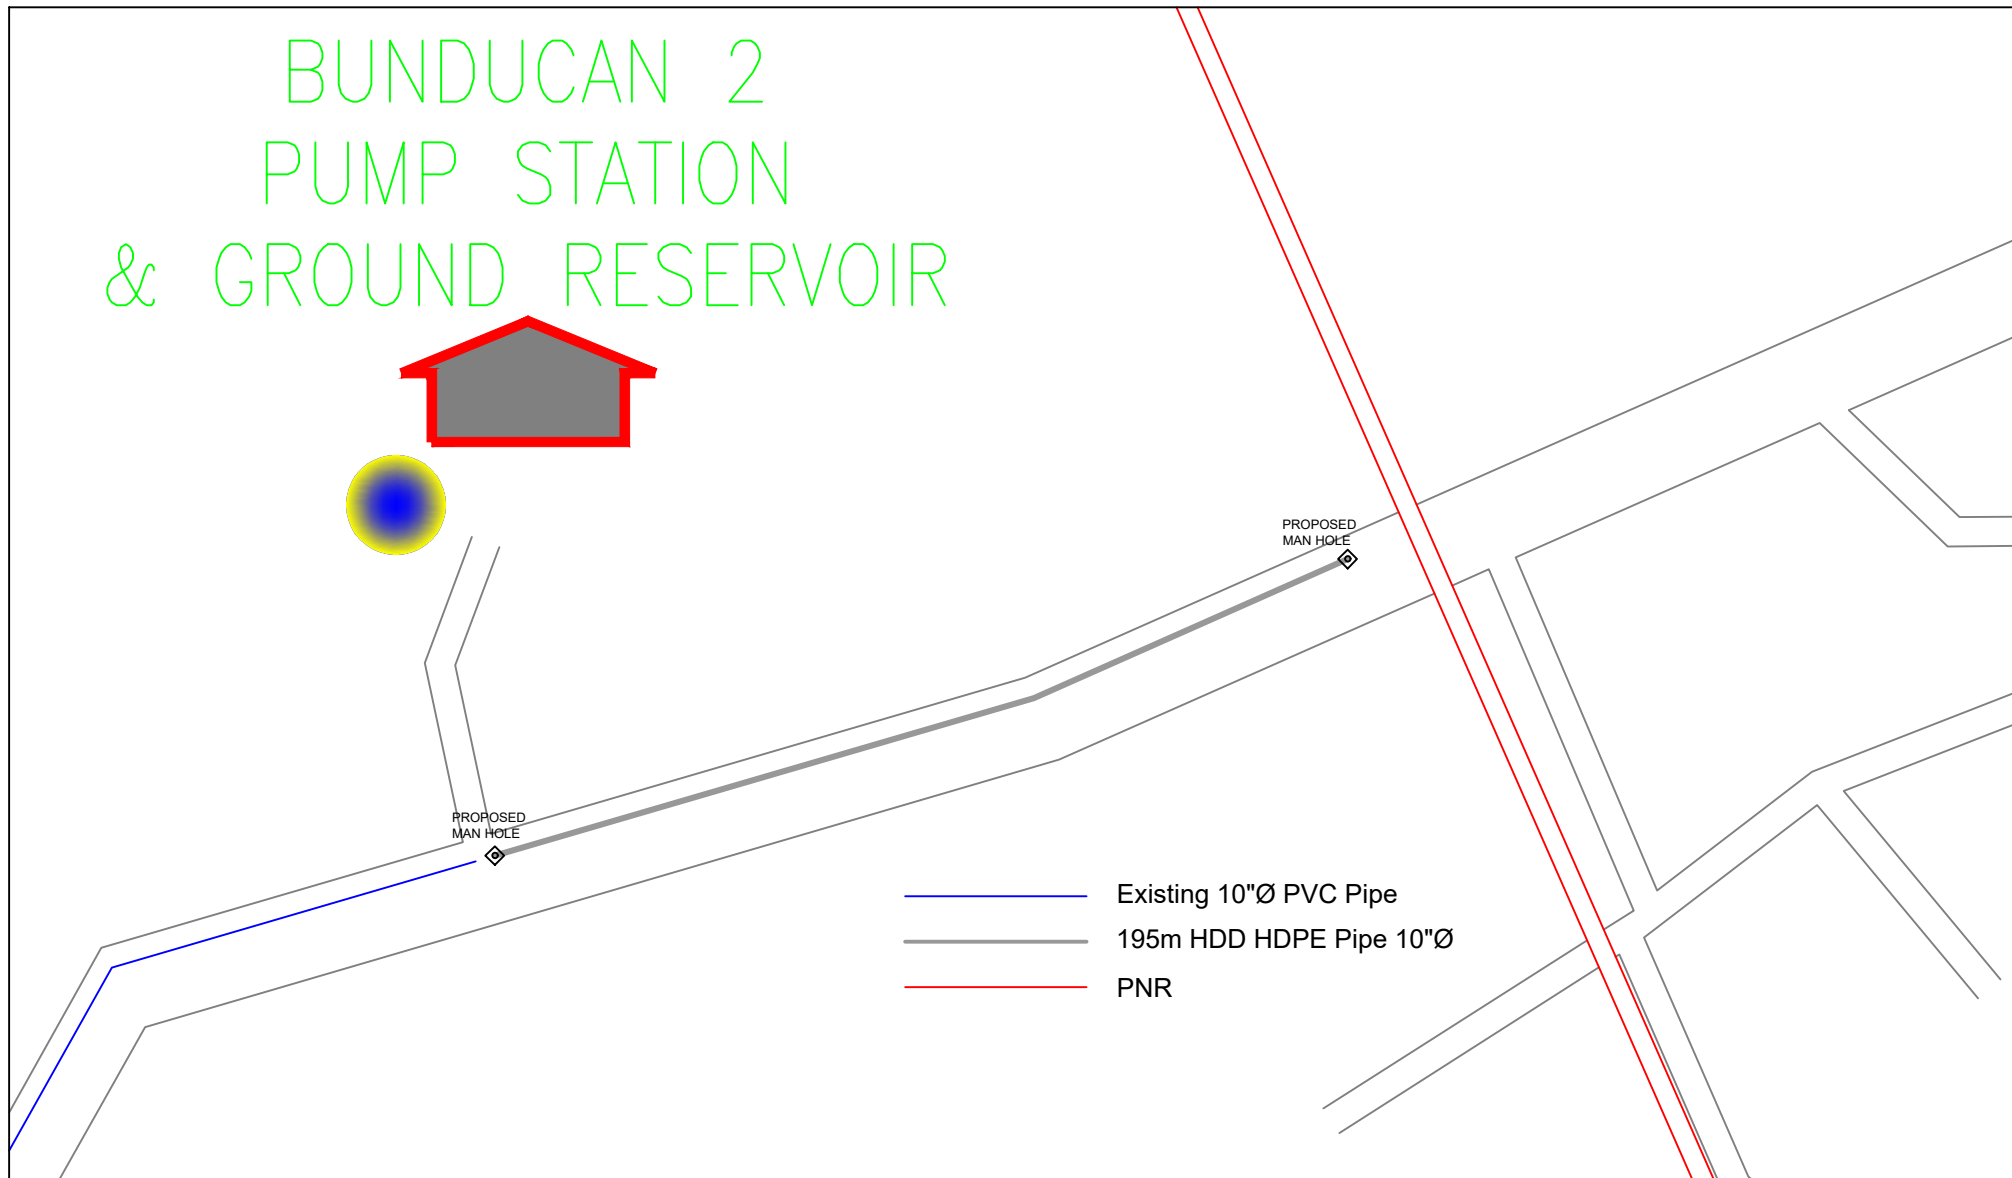

BOCAUE WATER DISTRICT

130 Gov. F. Halili Ave. Ext.,  
Biñang 2nd, Bocaue, Bulacan

Bunducan Provincial Road

SCALE: NTS

Prepared by:

SGD Engr. Mark Christian J. Nunag

Sr. Engr. -A

Checked and Verified by:

SGD Engr. Roberta U. Santos

Division Manager B - P&E

Approved by:

SGD Engr. Ricardo B. Perez

General Manger